

# A New-Coupled-Inductor Circuit Breaker for DC Applications

Keith A. Corzine, *Senior Member, IEEE*

**Abstract**—In order to eliminate power conversion steps, future microgrids with renewable energy sources are being visualized as dc power systems. System components such as sources (solar panels, fuels cells, etc.) loads, and power conversion have been identified and are readily available. However, when it comes to dc circuit breakers, many designs are still in the experimental phase. The main limitation is that interrupting a current which does not have a zero crossing will sustain an arc. This paper introduces a new type of dc circuit breaker. It uses a short conduction path between the breaker and load as well as mutual coupling to automatically and rapidly switch OFF in response to a fault. The proposed breaker also can have a crowbar type switch at the output so that it can be used as a dc switch. Mathematical analysis, detailed simulation, and laboratory measurements of the new dc switch are included.

**Index Terms**—Circuit breaker, fault location, fault protection, power system protection, thyristor circuits.

## I. INTRODUCTION

DC electric power is seen as beneficial in a host of modern applications, such as electric ships, data centers, microgrids with renewable energy, and future applications such as the dc home. As researchers consider design of dc power systems, fault protection, and the circuit breaker are of significant interest. Along these lines mechanical breakers for ac systems can be used [1], but with limited range. Hybrid mechanical/solid-state breakers have been introduced [2]–[5] with the benefit of low losses. Another protection method that has been suggested is to utilize converters and associated control [6]–[9]. Alternatively, solid-state dc circuit breakers have been considered [10]–[17]. These breakers offer rapid response to faults, but tend to have higher power losses. The z-source breaker [18]–[25] is a recently developed type of solid-state breaker that automatically responds to faults. It has advantages of very rapid operation and automatic disconnection of faulty loads. This paper presents a new concept in dc circuit breakers which is closely related to the z-source dc breaker, but with utilization of transformer coupling. Only recently have researchers suggested coupled inductors not only for fault detection, but for automatic isolation [26]–[29]. As shown below, the breaker introduced herein has advantages over the z-source breaker in terms of requiring fewer components. It

Manuscript received October 17, 2015; revised January 22, 2016; accepted March 8, 2016. Date of publication March 10, 2016; date of current version November 11, 2016. This paper was presented in part at the *IEEE International Conference on DC Microgrids*, Atlanta, GA, USA, June 2015. Recommended for publication by Associate Editor P. Barbosa.

The author is with the Department of Electrical and Computer Engineering, Clemson University, Clemson, SC 29634 USA (e-mail: Corzine@Clemson.edu).

Color versions of one or more of the figures in this paper are available online at <http://ieeexplore.ieee.org>.

Digital Object Identifier 10.1109/TPEL.2016.2540930

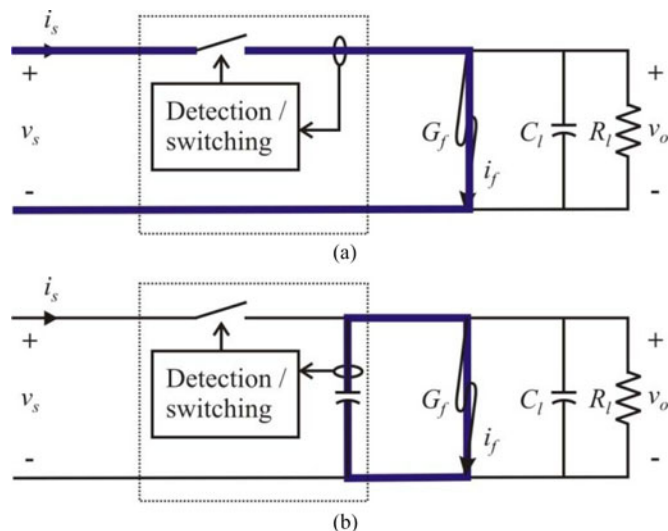


Fig. 1. Fault sensing techniques. (a) Fault sensing using a path from the source. (b) Fault sensing using a path from the breaker.

also has a settable level for fault current; that is through breaker design the transformer turns ratio can be selected to specify how much fault current is needed for the breaker to operate.

Fig. 1(a) shows a typical arrangement of a circuit breaker inserted between a source and load. In this circuit, the source current is monitored for fault current detection. Alternatively, a capacitor can be connected to ground within the breaker as shown in Fig. 1(b). This method is good for detecting transient currents and is used in motor drives for detection of shoot through. That is, a small capacitor in series with some type of current sensor can be connected to the dc bus of a drive. Shoot-through faults create an impulse of current in this capacitor and the detection can immediately switch OFF the drive's gate signals. Likewise, a short path could be added to any type of dc circuit breaker for fast detection of faults. Instead of monitoring the main path current (between source and load) and allowing the source to experience the fault current for a while, the short path between the added capacitor and load readily indicates the fault.

## II. PROPOSED DC PROTECTION CIRCUIT

Now, the abovementioned technique is admirable but, in addition, the short path can be used as a means of switching the breaker off in response to a fault. Consider the proposed dc circuit breaker shown in Fig. 2. During the normal steady-state operation, current flows from the source to the load through the SCR and coupled inductors. A fault on the load side will cause an impulse current  $i_c$  in the short path containing the capacitor

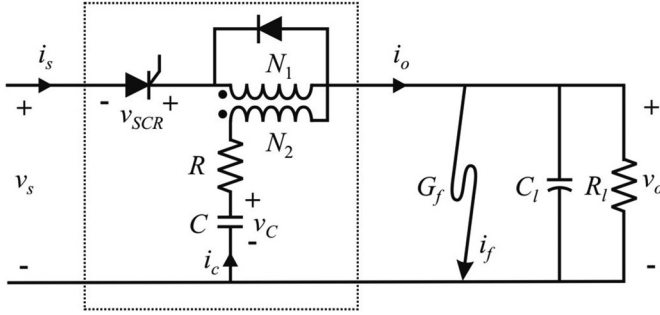


Fig. 2. Proposed dc circuit breaker.

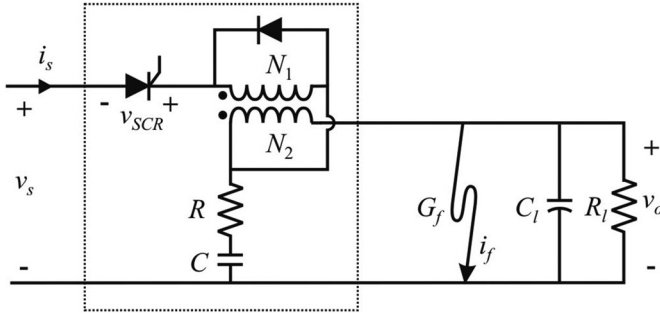


Fig. 3. Variation of the proposed dc circuit breaker.

and secondary winding of the coupled inductors. With a turn's ratio, this current is reflected to the primary and essentially pushes the SCR current to zero; at which time the SCR switches OFF. It should be noted that the turn's ratio  $N_1/N_2$  can also be set so that the breaker does not identify a large change in load as a fault.

An alternate approach to the proposed breaker is the variation shown in Fig. 3. In this circuit, the main path current flows through the primary and secondary windings. As with the circuit of Fig. 2, the fault current flows through the secondary winding and causes the SCR current to go to zero.

### III. DESIGN AND ANALYSIS

#### A. Step Load Analysis

One of the main features of the proposed dc switch is its ability to remain on during a step change in load. Therefore, it is helpful to know how to design the transformer component and know exactly what type of step in load will cause the breaker to switch OFF. From Fig. 1 and neglecting transformer magnetizing current

$$i_s = i_o - \frac{N_2}{N_1} i_c. \quad (1)$$

For steady-state operation, the capacitor current is zero and the source current is equal to the output current. Assuming that a sudden change in output current is entirely represented by a change in capacitor current, that is

$$\Delta i_c \approx \Delta i_o. \quad (2)$$

TABLE I  
PARAMETERS OF THE TEST SYSTEM

$N_1 = 70$	$r_1 = 0.373 \Omega$	$L_{l1} = 51 \mu\text{H}$	$L_{m1} = 960 \mu\text{H}$
$N_2 = 24$	$r_2 = 0.128 \Omega$	$L_{l2} = 6 \mu\text{H}$	$L_{m2} = 116 \mu\text{H}$
$R = 0.2 \Omega$	$C = 100 \mu\text{F}$		
$V_{RRM} = 400 \text{ V}$	$I_{TRMS} = 40 \text{ A}$	$t_q = 35 \mu\text{s}$	

By transformer action

$$\Delta i_s \approx -\frac{N_2}{N_1} \Delta i_c \approx -\frac{N_2}{N_1} \Delta i_o. \quad (3)$$

Now, with an initial output current of

$$i_s = I_o \quad (4)$$

the response of the source current to a change in output current will be

$$i_s = I_o - \frac{N_2}{N_1} \Delta i_o. \quad (5)$$

This source current, and, thus, the SCR current, will go to zero when the change in output meets the condition

$$\Delta i_o > \frac{N_1}{N_2} I_o. \quad (6)$$

Therefore, (6) can be used to determine the amount of change in output current that will result in the breaker switching OFF. This can also be used to select a turn's ratio to ensure that the breaker will not switch OFF during expected load transients.

#### B. Circuit Design

The breaker designs starts with choosing a wire size and carrying out a design for the transformer primary winding. In this case, the wire size has a cross-sectional area of  $0.82 \text{ mm}^2$ . For this design, the transformer is going to be an air-core type wound around a square capacitor having dimensions of  $70 \text{ mm} \times 57.5 \text{ mm}$ . A number of turns are selected and 5% leakage inductance is assumed. The resulting parameters are displayed in Table I. In this case, a turns ratio of approximately three is selected so that the transient load current can step by about 300%, as per (6), without switching the breaker off. Using the same wire size as the primary, the secondary parameters are computed and shown in Table I. In this design, the SCR total turn-off time  $t_q$  is taken into account and the resonance formed by  $L_{m2}$  and  $C$  is set that so a quarter cycle [18] is three times the turn-off time. This results in the value of capacitance in listed Table I. Finally, the resistance is set to a low value as not to interfere with the breaker performance, but still provide damping of the oscillations which occur when the breaker is switched OFF. The last row of Table I shows the SCR ratings. A laboratory test system operating with a 100-V 6-A dc load would be within the ratings of the SCR.

#### C. Circuit Analysis

Fig. 4 shows the equivalent circuit of the proposed breaker with the SCR conducting. In this circuit, the transformer resistance and leakage inductance are neglected.

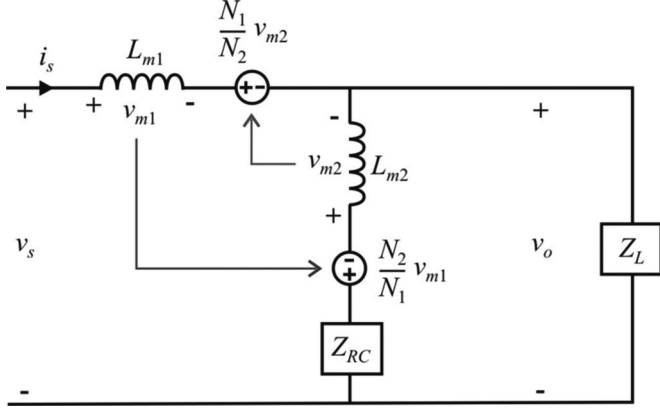


Fig. 4. Equivalent circuit of the proposed dc breaker.

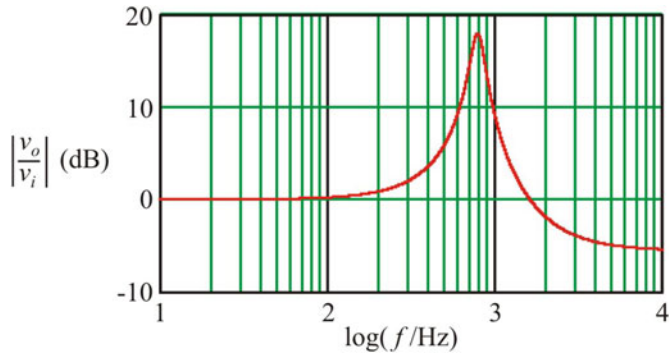


Fig. 5. Voltage transfer function of the proposed breaker.

In the equivalent circuit,  $Z_{RC}$  is the series combination of  $R$  and  $C$  and  $Z_L$  is the parallel combination of  $R_l$  and  $C_l$ . Furthermore,  $L_{m1}$  and  $L_{m2}$  are the primary and secondary magnetizing inductances of the transformer, respectively. From the equivalent circuit, it can be determined that the voltage transfer function is

$$\frac{v_o}{v_s} = \frac{s(L_{m2} - L_{12}) + Z_{RC}}{s\left(\frac{L_{m1}Z_{RC}}{Z_L} + L_{m1} + L_{m2} - 2L_{12}\right) + Z_{RC}} \quad (7)$$

and the impedance as seen from the source is

$$\frac{v_s}{i_s} = \frac{s\left(\frac{L_{m1}Z_{RC}}{Z_L} + L_{m1} + L_{m2} - 2L_{12}\right) + Z_{RC}}{s\left(\frac{L_{m2}}{Z_L} + \frac{L_{m2}}{Z_{RC}} - \frac{L_{12}^2}{L_{m1}Z_{RC}}\right) + \frac{Z_{RC}}{Z_L} + 1} \quad (8)$$

where

$$L_{12} = \sqrt{L_{m1}L_{m2}}. \quad (9)$$

Fig. 5 shows the voltage transfer function according to (7) for the proposed breaker with parameters in Table I. In this example,  $R_l = 50 \Omega$  and  $C_l = 0$ . At low frequencies, it has unity gain. There is a resonance around 800 Hz and the breaker attenuates signals of higher frequency. The transfer function is similar to that of a notch filter with attenuation at high frequencies.

It is instructive to look at the proposed circuit in terms of its Thevenin equivalent. With the device open-circuited, the Thevenin voltage can be seen to be  $v_s$ . Based on mathematical

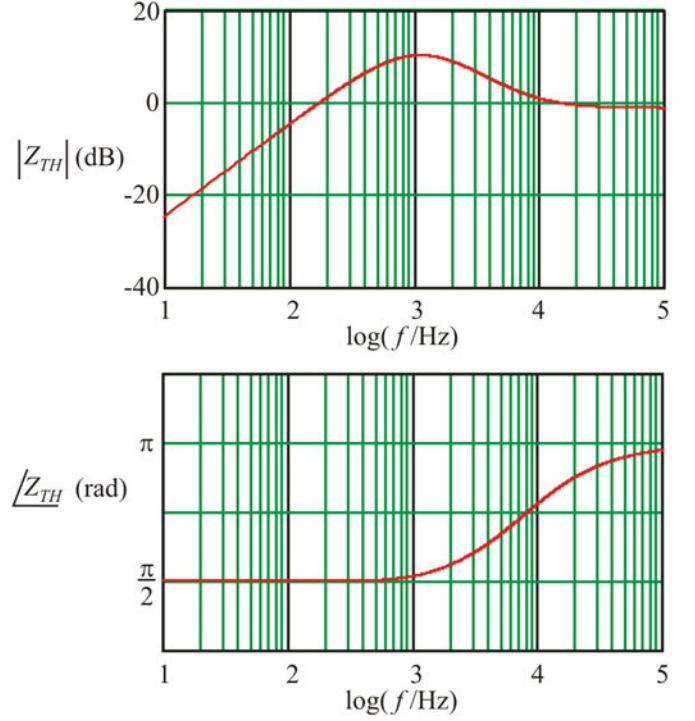


Fig. 6. Thevenin impedance of the proposed breaker.

circuit analysis, the Thevenin impedance is seen to be

$$Z_{TH} = \frac{sL_{m1}Z_{RC}}{s(L_{m2} - L_{m1}) + Z_{RC}}. \quad (10)$$

Using the parameters from before, the plot of Thevenin impedance is shown in Fig. 6. At low frequencies, this is seen as inductive and has the value  $L_{m1}$ . This is seen from (10) and that  $Z_{RC}$  is an open-circuit at low frequencies. At high frequencies, the Thevenin impedance becomes a negative resistor. Thus, considering the Thevenin equivalent, applying a transient or high-frequency fault results in current flow back to the source which causes the source (or SCR) current to go to zero.

The dc circuit breaker presented herein is most similar to the z-source breaker in that it automatically responds to faults. A number of researchers have produced variations of the z-source breaker. Herein, these are denoted as the classic z-source breaker [18], [19], [21], [22], [24], the series z-source breaker [19], [21], the modified series z-source breaker [20], [25], and the new series breaker [23]. For clarity, these are depicted in Fig. 7. A comparison of the various dc breaker topologies is shown in Table II. The “+” symbol in a column indicates where that circuit has an advantage, the “-” indicates a disadvantage, and the “0” represents a neutral comparison.

As can be seen, the classic z-source breaker had a number of limitations. A common ground between the source and load was established with the series design but then the source current would ring after the SCR switched OFF. This is an inconvenience since the source current can ring up to a large value and inductance must be increased to limit this ringing. The modified series design also addressed the common ground and further has the

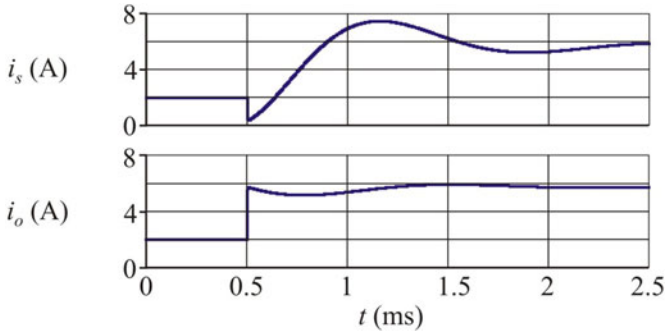


Fig. 7. Breaker response to a step change in load.

TABLE II  
COMPARISON TO Z-SOURCE BREAKER VARIANTS

	Classic	Series	Modified series	New series	Proposed
Common source/load ground	-	+	+	+	+
Low-pass filter transfer function	-	-	+	+	<b>0</b>
Invariant to load steps	-	-	-	+	+
No ringing in source current	+	-	-	-	+

desirable property that its transfer function has a low-pass form. Up to this point, all the designs could mistake a step change in load of more than 100% as a fault. The new series design eliminated this by providing an additional branch for the fault current. However, the source current ringing was still there. The proposed breaker can be seen to have all of the advantages listed in Table II. Furthermore, the proposed breaker has much fewer components. The only questionable property of the proposed breaker is the voltage transfer function. From Fig. 5, it can be seen that the proposed breaker does attenuate high frequencies, but not at the rate of a traditional low-pass filter.

#### D. Transient Analysis

An approximate transient analysis in response to a step change in load can be carried out using the circuit of Fig. 4. First, the following approximations are made. The fault is assumed to be an ideal short-circuit at the output. The resistance in the impedance  $Z_{RC}$  is assumed to be negligible. The turn's ratio is such that only a negligibly small voltage is induced in the transformer secondary. With these assumptions, the capacitor current is found to be

$$i_C \approx v_s \sqrt{\frac{C}{L_{m2}}} \sin(\omega_o t) \quad (11)$$

where

$$\omega_o = (L_{m2}C)^{-\frac{1}{2}}. \quad (12)$$

From the circuit in Fig. 4 and (11), one can arrive at

$$pi_s = \frac{v_s}{L_{m1}} \left[ 1 - \frac{N_1}{N_2} \cos(\omega_o t) \right]. \quad (13)$$

From which it is seen that the source (thus SCR) current is

$$i_s = I_o + \frac{v_s}{L_{m1}} t - v_s \sqrt{\frac{C}{L_{m1}}} \sin(\omega_o t) \quad (14)$$

where  $I_o$  is the steady-state source current before the fault occurred; as defined above. Much insight into the operation of the proposed circuit can be obtained from the above analysis. First, (11) suggest a sinusoidal pulse in current, which, along with the source current, will flow to the breaker output. Therefore, the fault current will have roughly the shape of (11) and its peak value and pulse duration can be predicted. Next, from (14), it can be determined exactly when the source current will reach zero; thus, a prediction of how fast the breaker can switch OFF can be made. Note that (14) suggest an increasing component in the current in the second term which in reality will be swamped by the decreasing component of the third term. Also, it can be seen that with a poor choice of parameters (capacitance, inductance, and turns ratio), the current may never go to zero. This can be predicted by taking the derivative of (14) and seeing if the minimum current is above zero. A practical example of this is given below.

#### E. Detailed Simulation

Based on the parameters of Table I, a detailed simulation was carried out. In this study, the source voltage is 100 V and the load is purely resistive. Fig. 7 shows the source and load currents when the load is stepped from 50 to 16.7  $\Omega$ . The variables are the same as those labeled in Fig. 2. As can be seen, the load current steps from 2 to 6 A. This causes a step in capacitor current which reflects back to the source current causing it to dip, but not quite to zero. In fact, applying the criteria (6) with  $I_o = 2$  A and the turns ratio given in Table I, states that a change of output current by  $\Delta i_o > 5.83$  A would cause the breaker to switch OFF. This says that the output current can step from 2 up to 7.83 A without switching the breaker off. Therefore, the SCR stays on and the source current goes to 6 A after the transient.

Fig. 8 shows the response of the proposed breaker to a fault. In this study, the source voltage is 100 V and the load resistance is 16.7  $\Omega$ . A bolted fault occurs at the output which is represented by a 10-m $\Omega$  resistance. As the output current starts to rise, the current reflected in the transformer causes the source current to directly go to zero in microseconds. After the SCR switches OFF, the load current goes up to over 100 A as the capacitor discharges. Incidentally, the approximate analysis of (11) predicts a peak fault current of 99 A. The SCR voltage first goes positive, and it is, thus, reverse biased for about 100  $\mu$ s; allowing the SCR to completely turn off. When the SCR voltage goes negative and is equal in magnitude to the source voltage, the diode switches ON stopping the resonance.

#### IV. LABORATORY VALIDATION

A laboratory prototype of the proposed breaker was constructed according to the parameters of Table I. Fig. 9 shows a photograph of the laboratory breaker. In this circuit, the transformer connections are wound around the capacitor (seen in the bottom left) for better volume density. The magnetic field

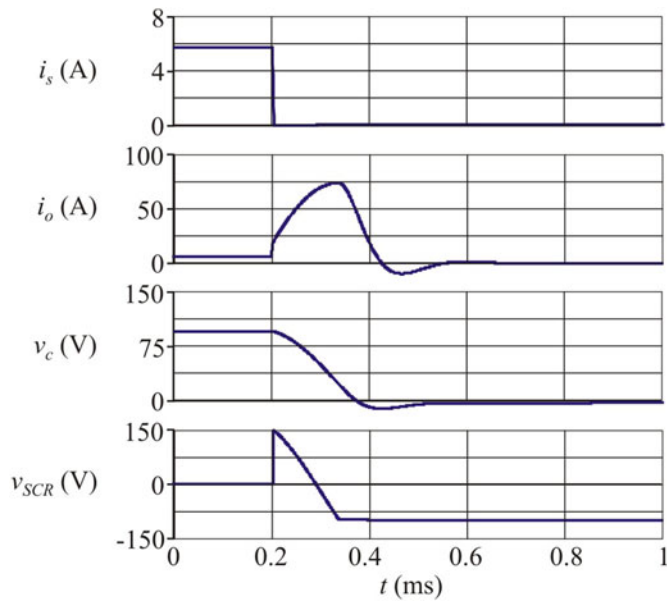


Fig. 8. Breaker response to a fault.

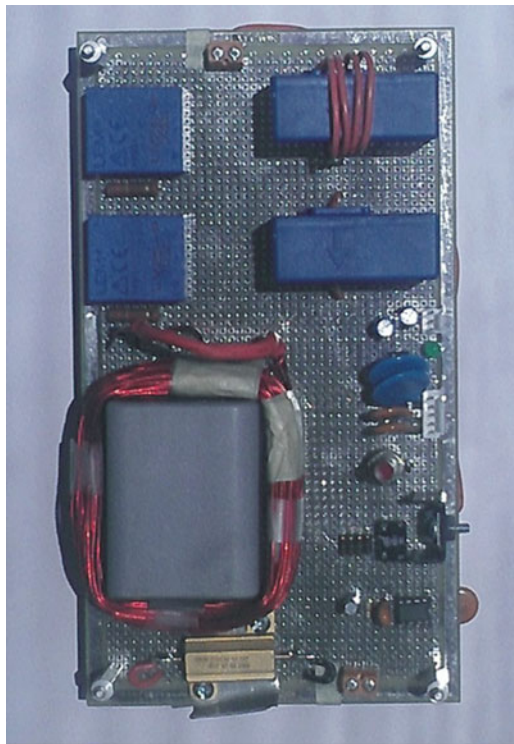


Fig. 9. Laboratory dc breaker.

will be unaffected by the capacitor and the effective air-core inductor will not experience saturation during transients. The SCR is seen at the right and the resistor is seen at the bottom of the board. The top half of the board contains voltage and current transducers which are used only for obtaining waveforms.

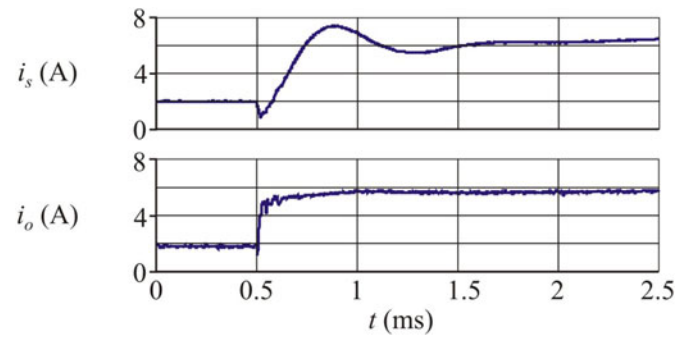


Fig. 10. Measured response to a step change in load.

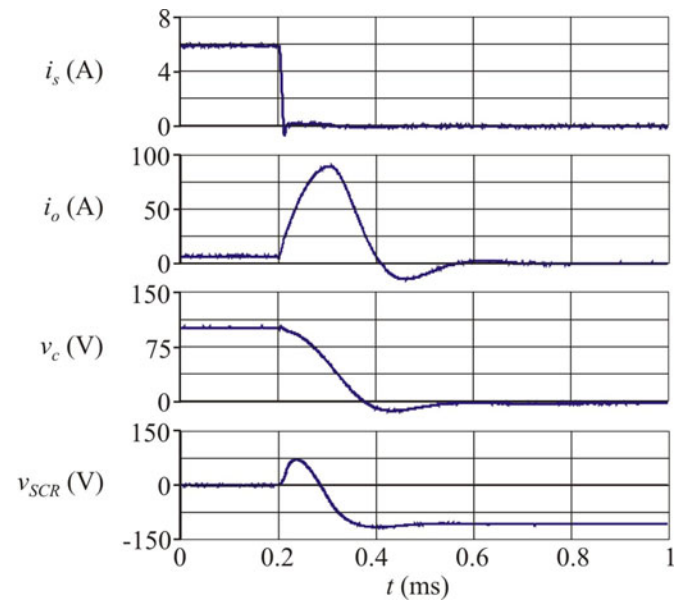


Fig. 11. Measured response to a fault.

Fig. 10 shows the source and output current in response to a step change in load. The output current can be seen to step from 2 to 6 A. The transient component of this current is reflected through the transformer causing the source current to dip. However, since the current does not go to zero, the SCR continues to conduct. After a transient within the circuit, the source current matches the load current.

Fig. 11 shows measured waveforms of the proposed breaker in response to a fault. The source current is seen to go to zero; at which time the SCR switches OFF. The output current reflects the fault current which increases to about 100 A until the output voltage drops causing the current to go to zero. The last trace shows the SCR voltage. After going off, the SCR is reverse biased for about 100  $\mu$ s, which is longer than the total turn-off time of the SCR.

## V. PRACTICAL CONSIDERATIONS

In this section, a medium-voltage design will be carried out to show how the proposed breaker may practically fit into a power system, such as an electric ship. Topology modifications, effect

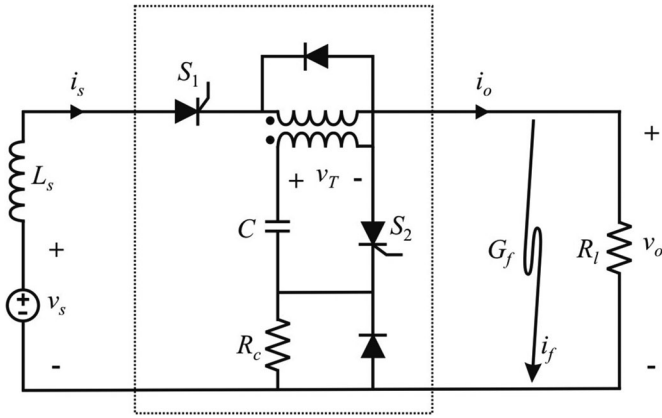


Fig. 12. Power system with modified dc switch.

of transformer leakage inductance, effect of source impedance, and rate of fault inception will be considered.

### A. Topology Modifications

Fig. 12 shows the proposed dc breaker inserted into a medium-voltage dc (MVDC) system. Two modifications to the breaker have been made. First, the  $RC$  impedance in the previous design has been replaced with a pure capacitance. In addition, a charging resistor  $R_c$  with an accompanying diode has been placed in series. The purpose of the charging resistor is to initially charge the capacitor. That is, when starting (or reenergizing) the breaker, the source voltage is established then the SCR, labeled  $S_1$ , is gated on. This causes a charging of the capacitor through the transformer and charging resistor. The desired charging time can be set using the time constant formed by  $C$  and  $R_c$ . Furthermore, the charging resistor limits the initial capacitor surge current. With the diode in parallel, the charging resistor is bypassed during fault operation and the breaker responds as described above.

The next modification to the breaker is a switch-OFF SCR, labeled  $S_2$ . This adds an important feature to the breaker in that it allows the circuit to be used as a dc switch. During steady-state operation, with the capacitor charged, gating on  $S_2$  discharges the capacitor into the secondary winding causing the breaker to switch OFF. Therefore, the breaker can be purposely switched OFF by gating  $S_2$ . Then, switched ON again by gating  $S_1$ . It is important to note that this added switch has the same effect as crow barring the output as suggested in [25]. However, since the switch is not placed at the output, it will not cause a short-circuit there.

### B. Medium-Voltage Design

The MVDC system has a source voltage of  $v_s = 1000$  V and a power level of 100 kW ( $R_l = 10 \Omega$ ). The source has an inductance of  $L_s = 10 \mu\text{H}$ . The design of the breaker was carried out by selecting a number of turns, turns ratio, and wire diameter that supports full current (in this case, the wire cross-sectional area is  $0.42 \text{ cm}^2$ ). In this case, a leakage inductance of 10% is assumed. The transformer is made as an air core with a

TABLE III  
PARAMETERS OF THE MVDC BREAKER DESIGN

$N_1 = 40$	$r_1 = 10.3 \text{ m}\Omega$	$L_{l1} = 69 \mu\text{H}$	$L_{m1} = 625 \mu\text{H}$
$N_2 = 14$	$r_2 = 3.62 \text{ m}\Omega$	$L_{l2} = 85 \mu\text{H}$	$L_{m2} = 77 \mu\text{H}$
$R_c = 100 \Omega$	$C = 100 \mu\text{F}$		
$V_{\text{RRM}} = 1200 \text{ V}$	$I_{\text{TRMS}} = 275 \text{ A}$	$t_q = 25 \mu\text{s}$	

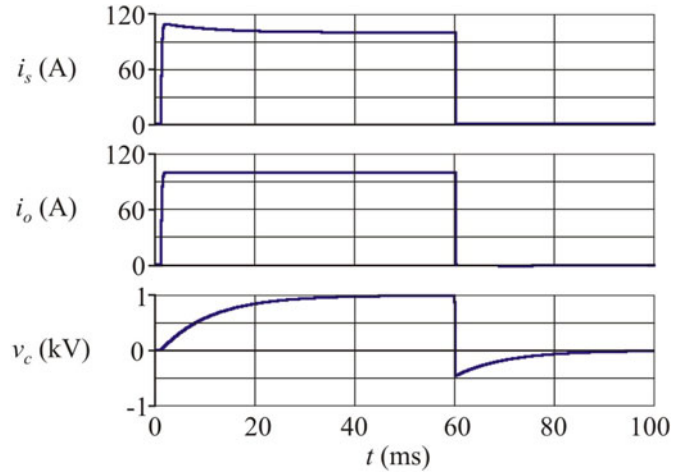


Fig. 13. Simulation demonstrating switch-OFF capability.

solenoid structure with a radius of about 10 cm which has a mass of 13 kg and a volume of 16 L. Table III shows the transformer parameters.

The breaker capacitance is set to  $100 \mu\text{F}$  and the charging resistance is set to  $100 \Omega$ . This seems quite reasonable since the capacitor charging current will have a peak value of 10 A (based on  $v_s = 1000$  V and  $R_c = 100 \Omega$ ). Furthermore, the charging time constant will be (based on  $C = 100 \mu\text{F}$  and  $R_c = 100 \Omega$ ).

For this design, a Vishay ST173S12EJ0-PbF SCR was used which has sufficient voltage and current ratings. The SCR is a fast turn-off type with a total turn off time of  $t_q = 25 \mu\text{s}$ .

Fig. 13 shows simulation results of the proposed breaker demonstrating closing and opening ability. First,  $S_1$  is fired and the capacitor is charged through  $R_c$ . Since the time constant here is 10 ms, the capacitor can be seen to be fully charged at 50 ms. At this point, the breaker is supporting a 100-kW load. At 60 ms,  $S_2$  is gated causing the capacitor to discharge in the transformer secondary and causing the proposed circuit to switch OFF. Thus, this added SCR can be used to purposely switch OFF the load.

Fig. 14 shows results of a simulation where the breaker switches OFF in response to a fault. Initially, the breaker is supporting a 30-kW load when the load is suddenly increased to 100 kW. As can be seen, the source and output current step to rated load and the breaker does not switch OFF. This could be predicted using the turns ratio and (6). Also note that the voltage across the transformer  $v_T$  spikes to about 500 V. A measurement of this voltage could be used to differentiate between a step change in load and a fault. The fault is applied at the end of the simulation and the output current surges, causing the breaker to switch OFF and the source current simply goes to zero. Note

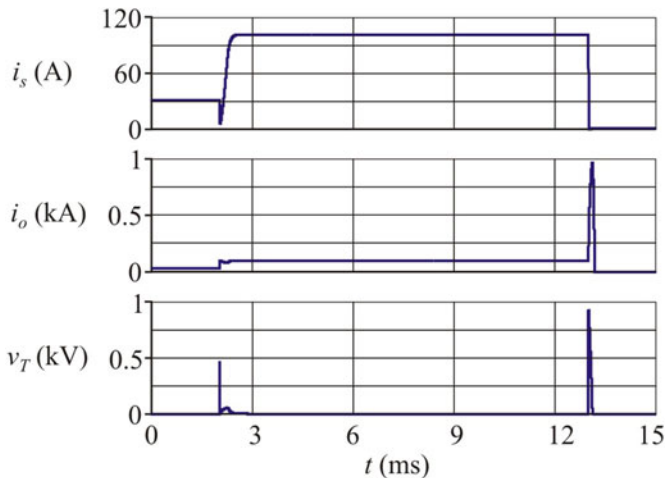


Fig. 14. Simulation demonstrating fault handling.

that the transformer voltage  $v_T$  spikes to about 1 kV when the fault is applied. Thus, the voltage  $v_T$  may be of some use in indicating faults. As a control signal, a measure of  $v_T$  may be useful in removing the signal to  $S_1$  for autonomous operation [25].

### C. Effect of Grid Impedance and Leakage Inductance

In traditional breaker circuits, there is a limit to the amount of grid impedance that can exist for the breaker to work [30] which is sometimes expressed as the  $L/R$  ratio of source inductance to fault resistance [30]. The source inductance was illustrated in Fig. 12, and can be included in the transient analysis. First, using (13), it is seen that the source current is a minimum when

$$t_{\min} = \sqrt{L_{m2}C} \cos^{-1} \left( \frac{N_2}{N_1} \right). \quad (15)$$

Now, by including the source inductance, (14) becomes

$$i_s = I_o + \left( \frac{v_s}{L_{m1} + L_s} \right) t - \left( \frac{v_s}{L_{m1} + L_s} \right) \sqrt{L_{m1}C} \sin(\omega_o t). \quad (16)$$

Substituting (15) into (16) and requiring that the source current go to zero in order for the SCR to switch OFF, the source inductance is

$$L_{s,\max} = \frac{v_s}{I_o} \left[ \sqrt{L_{m1}C} \sin(\omega_o t_{\min}) - t_{\min} \right] - L_{m1}. \quad (17)$$

Essentially, the breaker will not switch OFF if the source inductance is greater than that predicted by (17). In this case, the fault current will continue to be drawn from the source; a phenomenon noted in the literature [27]. For the medium-voltage design in Table III, (17) predicts a maximum allowable source inductance of 600  $\mu\text{H}$ . According to detailed simulation, the source inductance can be raised to 700  $\mu\text{H}$  before the breaker fails; the slight difference owed to the approximation in (11).

Considering the circuit of Fig. 12 and the equivalent circuit of Fig. 4, it can be seen that including leakage inductance in the pri-

mary winding has the same effect as adding source inductance. Also, note that the calculation of  $L_{s,\max}$  for this design is much less than the leakage inductances shown in Table III. Furthermore, a relatively large value of 10% leakage inductance was used in this design. Considering these facts, the effect of leakage inductance on the breaker operation is negligible compared to the effect of source inductance.

### D. Fault Inception

The proposed circuit, along with the z-source breaker, rely on fast fault inception [18]. Consider the medium-voltage design in Table III operating from an ideal source. Using detailed simulation, it was determined that if the fault conductance is ramped from 0 to 100 S in a time greater than 17.2 ms, the breaker fails to isolate the fault. That is, in this case, the breaker will not automatically respond to a fault that ramps its conduction slower than 5814 S/s. In cases like this, monitoring the transformer voltage  $v_T$  is of a little use because it depends on the rate of change of output current. In this case, what is recommended is monitoring the output current and comparing it to a threshold. When the threshold is reached,  $S_2$  can be fired so that the fault is cleared. Using this method, the proposed circuit operates much like a traditional solid-state circuit breaker. Therefore, the proposed breaker will always operate in a similar way to other breakers, but will have the added capability of automatically and quickly responding to faults with rapid inception.

## VI. CONCLUSION

As dc sources and dc microgrids become more prevalent, a solution is sought for dc switches and circuit breakers. Traditional methods relied on oversized ac breakers, hybrid breakers, and solid-state breakers. The dc switch proposed in this paper is a variation on the solid-state breaker, but has the added feature that it can automatically switch OFF in response to faults. Furthermore, there the turn's ratio in the circuit's transformer allows the designer to determine the amount of transient current that will be identified as a fault; as opposed to a step change in load. Analysis, design, and laboratory measurements demonstrate the proposed breaker's response to a step change in load and to a fault. The breaker compares favorably to recent designs in that it has a common ground between source and load, is invariant to step changes in load, and does not produce ringing resonance in the source current.

## REFERENCES

- [1] R. Cuzner, D. MacFarlin, D. Clinger, M. Rumney, and G. Castles, "Circuit breaker protection considerations in power converter fed dc systems," in *Proc. IEEE Electr. Ship Technol. Symp.*, Apr. 2009, pp. 360–367.
- [2] B. Bolanowski and F. Wojcik, "A fast dc hybrid circuit breaker," presented at the IEEE Colloq. Electronic-Aided Current-Limiting Circuit Breaker Developments Applications, London, U.K., Nov. 1989.
- [3] A. Pokryvailo and I. Ziv, "A hybrid repetitive opening switch for inductive storage systems and protection of dc circuits," in *Proc. IEEE Power Modulator Symp. High-Voltage Workshop*, 2002, pp. 612–615.
- [4] C. Meyer, M. Kowal, and R. W. De Doncker, "Circuit breaker concepts for future high-power dc-applications," in *Proc. IEEE Ind. Appl. Soc. Conf.*, 2005, vol. 2, pp. 860–866.

- [5] A. Shukla and G. D. Demetriades, "A survey on hybrid circuit-breaker topologies," *IEEE Trans. Power Del.*, vol. 30, no. 2, pp. 627–641, Apr. 2015.
- [6] D. Salomonsson, L. Soder, and A. Sannino, "Protection of low-voltage dc microgrids," *IEEE Trans. Power Del.*, vol. 24, no. 3, pp. 1045–1053, Jul. 2009.
- [7] J. Candelaria and J. D. Park, "VSC-HVDC system protection: A review of current methods," in *Proc. IEEE Power Energy Soc. Power Syst. Conf.*, Mar. 2011, pp. 1–7.
- [8] P. Nuutinen, P. Peltoniemi, and P. Silventoinen, "Short-circuit protection in a converter-fed low-voltage distribution network," *IEEE Trans. Power Electron.*, vol. 28, no. 4, pp. 1587–1597, Apr. 2013.
- [9] I. A. Gowaid, G. P. Adam, A. M. Massoud, S. Ahmed, D. Holliday, and B. W. Williams, "Quasi two-level operation of modular multilevel converter for use in a high-power dc transformer with dc fault isolation capability," *IEEE Trans. Power Electron.*, vol. 30, no. 1, pp. 108–123, Jan. 2015.
- [10] P. M. McEwan and S. B. Tennakoon, "A two-stage DC thyristor circuit breaker," *IEEE Trans. Power Electron.*, vol. 12, no. 4, pp. 597–607, Jul. 1997.
- [11] C. Meyer and R. W. De Doncker, "Solid-state circuit breaker based on active thyristors topologies," *IEEE Trans. Power Electron.*, vol. 21, no. 2, pp. 450–458, Mar. 2006.
- [12] R. Cuzner and G. Venkataramanan, "The status of dc micro-grid protection," in *Proc. IEEE Ind. Appl. Soc. Annu. Meet.*, pp. 1–8, Oct. 2008.
- [13] J. D. Park and J. Candelaria, "Fault detection and isolation in low-voltage dc-bus microgrid system," *IEEE Trans. Power Del.*, vol. 28, no. 2, pp. 779–787, Apr. 2013.
- [14] R. Schmerda, R. Cuzner, R. Clark, D. Nowak, and S. Bunzel, "Shipboard solid-state protection: Overview and applications," *IEEE Electr. Mag.*, vol. 1, no. 1, pp. 32–39, Sep. 2013.
- [15] J. Magnusson, R. Saers, L. Liljestrand, and G. Engdahl, "Separation of the energy absorption and overvoltage protection in solid-state breakers by the use of parallel varistors," *IEEE Trans. Power Electron.*, vol. 29, no. 6, pp. 2715–2722, Jun. 2014.
- [16] K. Sano and M. Takasaki, "A surgeless solid-state dc circuit breaker for voltage-source-converter-based HVDC systems," *IEEE Trans. Ind. Appl.*, vol. 50, no. 4, pp. 2690–2699, Jul./Aug. 2014.
- [17] Z. Miao, G. Sabui, A. Chen, Y. Li, Z. J. Shen, J. Wang, Z. Shuai, A. Luo, X. Yin, and M. Jiang, "A self-powered ultra-fast dc solid state circuit breaker using a normally-on SiC JFET," in *Proc. IEEE Appl. Power Electron. Conf. Expo.*, Mar. 2015, pp. 767–773.
- [18] K. A. Corzine and R. W. Ashton, "A new z-source dc circuit breaker," in *Proc. IEEE Int. Symp. Ind. Electron.*, Bari, Italy, Jul. 2010, pp. 585–590.
- [19] K. A. Corzine and R. W. Ashton, "Structure and analysis of the z-source MVDC breaker," in *Proc. IEEE Electr. Ship Technol. Symp.*, Alexandria VA, USA, Apr. 2011, pp. 334–338.
- [20] A. H. Chang, A. Avestruz, S. B. Leeb, and J. L. Kirtley, "Design of dc system protection," in *Proc. IEEE Electr. Ship Technol. Symp.*, Apr. 2013, pp. 500–508.
- [21] P. Prempraneerach, M. G. Angle, J. L. Kirtley, G. E. Karniadakis, and C. Chrysostomidis, "Optimization of a z-source dc circuit breaker," in *Proc. IEEE Electr. Ship Technol. Symp.*, Apr. 2013, pp. 480–486.
- [22] K. A. Corzine, "DC micro grid protection with the z-source breaker," presented at the IEEE Industrial Electronics Conf., Vienna, Austria, Nov. 2013.
- [23] A. Overstreet, A. Maqsood, and K. A. Corzine, "Modified z-source dc circuit breaker topologies," presented at the IEEE Clemson Power Systems Conf., Clemson, SC, USA, Mar. 2014.
- [24] A. Maqsood and K. A. Corzine, "The z-source breaker for ship power system protection," presented at the IEEE Electric Ship Technologies Symp., Alexandria VA, USA, Jun. 2015.
- [25] A. H. Chang, B. R. Sennett, A. Avestruz, S. B. Leeb, and J. L. Kirtley, "Analysis and design of dc system protection using z-source circuit breaker," *IEEE Trans. Power Electron.*, vol. 31, no. 2, pp. 1036–1049, Feb. 2016.
- [26] A. Maqsood and K. A. Corzine, "Z-source breakers with coupled inductors," presented at the IEEE Energy Conversion Congress Expo., Montreal, Canada, Sep. 2015.
- [27] J. Magnusson, R. Saers, and L. Liljestrand, "The commutation booster, a new concept to aid commutation in hybrid dc-breakers," presented at the Cigré Symp. HVDC, Lund, Sweden, May 2015.
- [28] Y. Liu, X. Wei, C. Gao, and J. Cao, "Topological analysis of HVDC circuit breaker with coupling transformer," in *Proc. IEEE Int. Conf. DC Microgrids*, Jun. 2015, pp. 129–134.
- [29] K. A. Corzine, "Circuit breaker for dc micro grids," in *Proc. IEEE Int. Conf. DC Microgrids*, Jun. 2015, pp. 221–221c.
- [30] E. Kontos, S. Rodrigues, R. Teixeira Pinto, and P. Bauer, "Optimization of limiting reactors design for DC fault protection of multi-terminal HVDC networks," in *Proc. IEEE Energy Convers. Congr. Expo.*, 2014, pp. 5347–5354.



**Keith A. Corzine** (S'92–M'97–SM'06) received the B.S.E.E., M.S.E.E., and Ph.D. degrees from the University of Missouri, Rolla, MO, USA, in 1992, 1994, and 1997, respectively.

He taught with the University of Wisconsin, Milwaukee, USA, the University of Missouri, and the Missouri University of Science and Technology, and is currently a Professor at Clemson University, Clemson, SC, USA. His research interests include power electronics, motor drives, naval ship propulsion systems, and electric machinery. He has published more than 50 refereed journal papers, more than 100 refereed international conference papers, and holds three U.S. patents related to power conversion. He was the Past Chair of the IEEE St. Louis Section.